

Denial of Service

The hidden cost of Deferred
Maintenance

Alan Stewart, PE
Honeywell Inc.

Denial of Service

- To withhold the necessary and code mandated support for habitation of facilities
- There are numerous support systems in modern buildings to:
 - Ventilate facilities
 - Clean and filter air
 - Control humidity

DOS Ventilation

- Poly sheeting over the outside air intake
- Broken or disconnected OA damper operators

DOS Filtration


- Dirty filters
- Missing Filters

DOS Humidity Control

- The air handler is growing the black stuff in the air handler and ductwork
- Occupant health impact

MR 12
LAD
BU2A. A101. P20
0.12.0.1.2
308
11-29-02

PRG (UL) CMP --- 50073

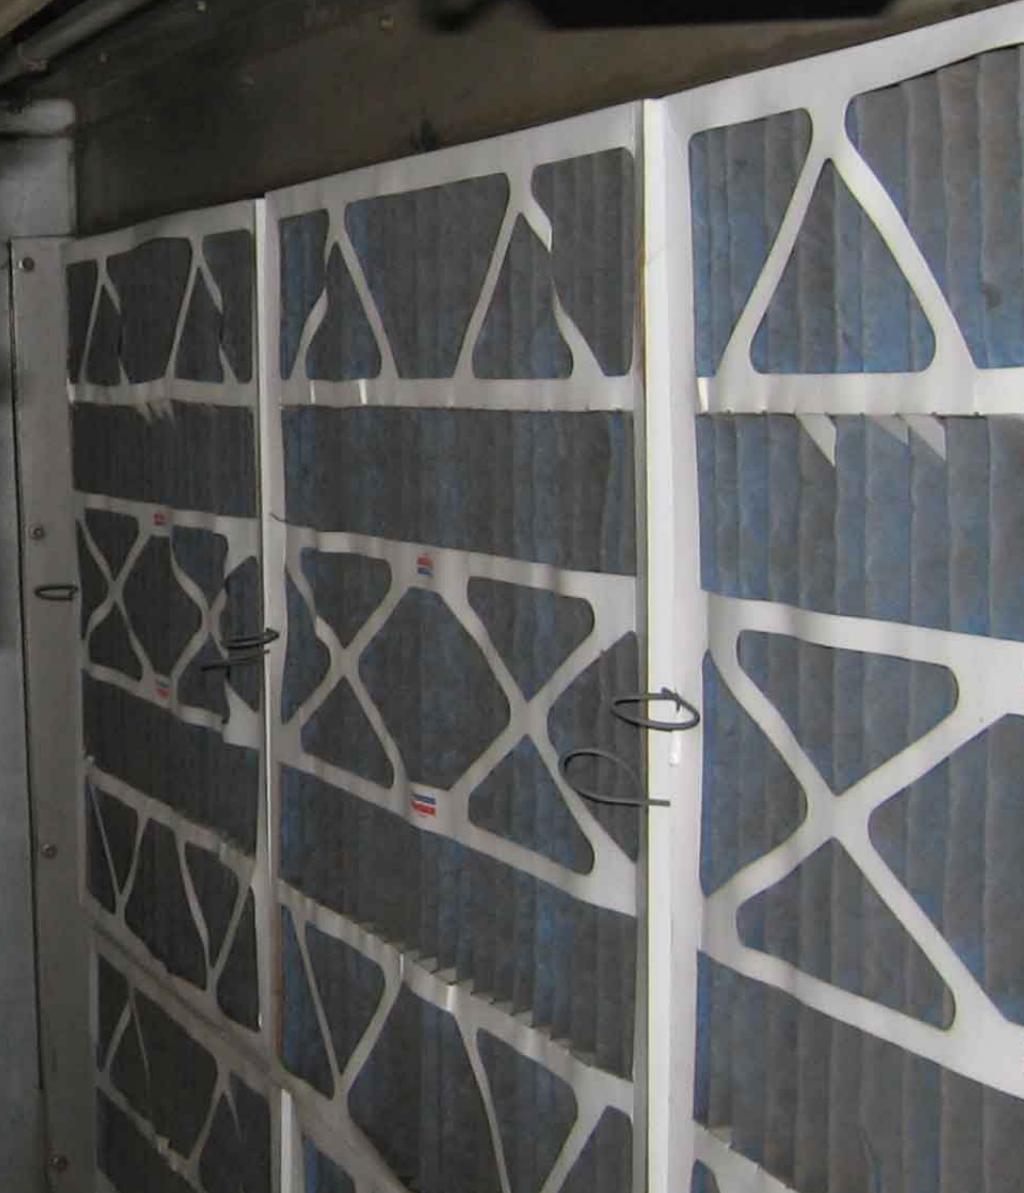



CAUTION
WET
PARKING
DRY

CAUTION
WET
PARKING
DRY











WARNING
PRESSURIZED BURNING FLUID
COMPRESSOR WITHOUT TERMINAL
ELECTRICAL POWER INCLUDING
BEFORE REMOVING
TERMINAL BOX COVER FOR SERVICING.
Do not touch terminal box cover in place
as it may be hot by de-energization
of unit.
K12072000-01 (02/08)











EXTECH 41029
118.
Thermometer

S11
7/2066

STEAM